



SUBMITTAL RECORD

JOB _____
 LOCATION _____
 SUBMITTED TO _____
 SUBMITTAL PREPARED BY _____
 APPROVED BY _____
 DATE _____


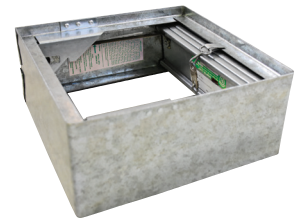


Submittal Form
UL10A-DY Dynamic
1-1/2 Hour Fire-Limit
UL Fire Damper
Vertical or Horizontal

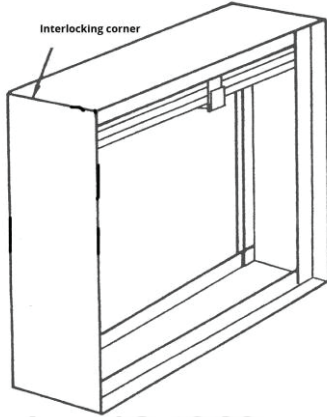

Approved by the Board of Standards and Appeals for use in New York City Cal. 291-80-SA

Accepted for use City of New York Department of Buildings MEA#: 302-00-M

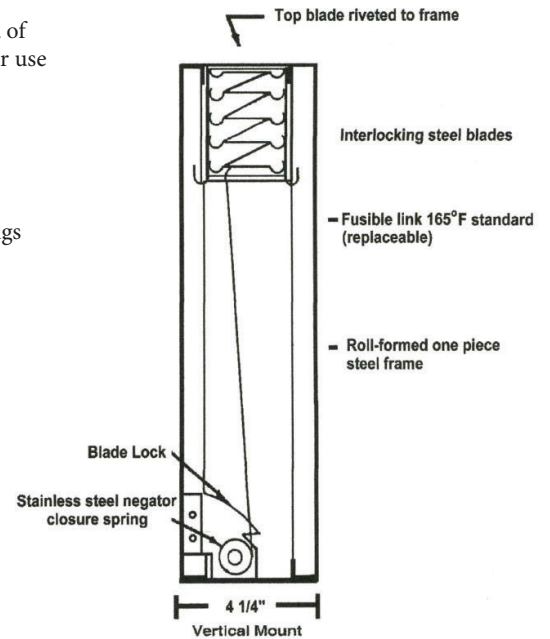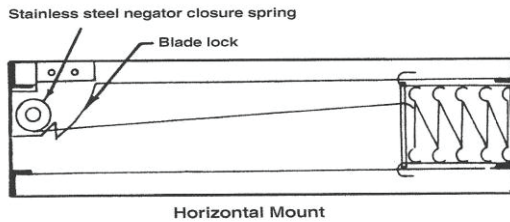

- Standard construction materials: Galvanized Steel
- Specification for all material per Underwriters' Laboratories Standard for Safety UL555.
- Underwriters' Laboratories: Labeled for use in sizes no larger than shown in U.L. Building Material List in a 2-hour fire partition.
- Meets National Fire Protection Assoc. - NFPA 90A
- Bi-Directional
- 2400 FPM Maximum Velocity
- 4.0 WG Maximum Static Pressure
- Features Vertical Closure Spring Operation under airflow in HVAC systems where fans remain running in fire and smoke control.
- Dynamic Fire Dampers bear a label attesting to airflow and maximum static pressure limits.

Damper Mounting Position	Minimum Damper Size (in.)		Single Section* Damper Size Maximum (in.)	
	Width	Height	Width	Height
Vertical	4	4	24	24
Horizontal	4	4	24	24

*Multi-Section not available.

SUGGESTED SPECIFICATIONS

Fire Dampers shall be Duro Dyne UL10A-DY Dynamic type dampers. Installation shall be as described in the Duro Dyne Fire Damper instructions. Sizes and locations shall be as indicated on the mechanical drawings.

Duro Dyne National Corporate Headquarters, Bay Shore, NY
 631-249-9000 • Fax: 631-249-8346
 Duro Dyne Midwest • Duro Dyne West • Duro Dyne Canada
 www.durodyne.com • E-mail: durodyne@durodyne.com



10/25/2022
 BO040019